



**BUREAU
VERITAS**

Certificate of compliance

Applicant: Wuxi Solinteg Power Co., Ltd.
Building H1-1001, No. 6 Jingxian Road, Xinwu District
214135 Wuxi, Jiangsu Province
China

Product: Photovoltaic and battery inverter (Hybrid-Inverter)

Model: M2HT-25K-150
M2HT-29.9K-150
M2HT-30K-150
M2HT-40K-150
M2HT-50K-150

The device is designed to work as a generation unit of the type: A

Inverter for three-phase parallel connection to the public grid. The network monitoring and disconnection device is an integral part of the above-mentioned model.

Applied rules and standards:

EN 50549-1:2019/A1:2023

Requirements for parallel connection of installations with distribution networks - Part 1: Connection to an LV distribution network - Production of installations up to and including Type B

- 4.4 Normal operating range
- 4.5 Immunity to disturbances
- 4.6 Active response to frequency deviation
- 4.7 Power response to voltage variations and voltage changes
- 4.8 EMC and power quality
- 4.9 Interface protection
- 4.10 Connection and starting to generate electrical power
- 4.11 Ceasing and reduction of active power on set point
- 4.13 Requirements regarding single fault tolerance of interface protection system and interface switch

EN 50549-10:2022

Requirements for generating plants to be connected in parallel with distribution networks - Part 10: Tests for conformity assessment of generating units

Compliance with the parameters in Annex C of the standard

(see appendix parameter table)

Commission Regulation (EU) 2016/631 of 14 April 2016

Establishing a network code on requirements for grid connection of generators (NC RFG).

Type approval for generation units to use in Type A plants.

At the time of issue of this certificate, the safety concept of an aforementioned representative product corresponds to the valid safety specifications for the specified use in accordance with regulations.


Report number: DGHC2412270311EGEU01

Certificate number: U25-0557

Certification Program: NSOP-0032-DEU-ZE-V10

Date of issue: 2025-06-13

Accreditation

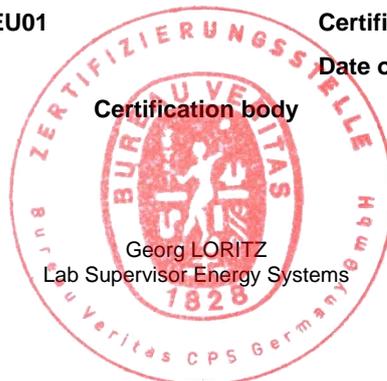

Accredited certification body by Deutsche Akkreditierungsstelle GmbH (DAkkS) according to ISO/IEC 17065. The accreditation is valid only for the scope listed in the annex of the accreditation certificate D-ZE-12024-01-00. The Deutsche Akkreditierungsstelle GmbH (DAkkS) is signatory of the multilateral arrangements of EA, ILAC and IAF for mutual recognition.

Without the written consent of Bureau Veritas Consumer Products Services Germany GmbH excerpts of this certificate of conformity shall not be reproduced.



BUREAU
VERITAS

Annex certificate of conformity No. U25-0557

Extract from test report DGHC2412270311EGEU01 issued by a testing laboratory accredited by "A2LA" according to ISO/IEC 17025. The accreditation is only valid for the scope listed in the annex of the accreditation certificate "5200.02".

Type Approval and declaration of compliance with the requirements of EN 50549-1 and Commission Regulation (EU) 2016/631 of 14 April 2016

Manufacturer	Wuxi Solinteg Power Co., Ltd. Building H1-1001, No. 6 Jingxian Road, Xinwu District 214135 Wuxi, Jiangsu Province China			
Product type	Photovoltaic and battery inverter (Hybrid-Inverter)			
Static converter model	M2HT-25K-150	M2HT-29.9K-150	M2HT-30K-150	M2HT-40K-150
Input DC (photovoltaic)				
MPP voltage range [V]	200-950	200-950	200-950	200-950
Max. input voltage [V]	1000	1000	1000	1000
Max. input current [A]	40*4	40*4	40*4	40*4
Input DC (battery)				
DC voltage range [V]	150-840	150-840	150-840	150-840
Battery Max. Charge/Discharge Current [A]	150/150	150/150	150/150	150/150
Output AC				
Rated AC voltage [V]	3L/N/PE,220/380,230/400Va.c	3L/N/PE,220/380,230/400Va.c	3L/N/PE,220/380,230/400Va.c	3L/N/PE,220/380,230/400Va.c
Max. output current [A]	37,9	45,3	45,5	60,6
Nom. converter output (P _{NINV}) [kW]	25,0	29,9	30,0	40,0
Rated apparent power [kVA]	25,0	29,9	30,0	40,0
In on-grid battery mode AC				
P _{sn} (nom. discharge power) [kW]	25,0	29,9	30,0	40,0
P _{cn} (nom. charging power) [kW]	25,0	29,9	30,0	40,0
P _{smax} (max. discharge power) [kW]	25,0	29,9	30,0	40,0
P _{cmax} (max. charging power) [kW]	25,0	29,9	30,0	40,0
Type	Bidirectional	Bidirectional	Bidirectional	Bidirectional
In off-grid battery mode				
P _{sn} (nom. discharge power) [kW]	25	29,9	30,0	40,0
P _{smax} (max. discharge power) [kW]	25	29,9	30,0	40,0



BUREAU
VERITAS

Annex certificate of conformity No. U25-0557

Extract from test report DGHC2412270311EGEU01 issued by a testing laboratory accredited by "A2LA" according to ISO/IEC 17025. The accreditation is only valid for the scope listed in the annex of the accreditation certificate "5200.02".

Static converter model				
M2HT-50K-150	--	--	--	--
Input DC (photovoltaic)				
MPP voltage range [V]	200-950	--	--	--
Max. input voltage [V]	1000	--	--	--
Max. input current [A]	40*4	--	--	--
Input DC (battery)				
DC voltage range [V]	150-840	--	--	--
Battery Max. Charge/Discharge Current [A]	150/150	--	--	--
Output AC				
Rated AC voltage [V]	3L/N/PE,220/380, 230/400Va.c	--	--	--
Max. output current [A]	75,8	--	--	--
Nom. converter output (P _{NINV}) [kW]	50,0	--	--	--
Rated apparent power [kVA]	50,0	--	--	--
In on-grid battery mode AC				
P _{sn} (nom. discharge power) [kW]	50,0	--	--	--
P _{cn} (nom. charging power) [kW]	50,0	--	--	--
P _{smax} (max. discharge power) [kW]	50,0	--	--	--
P _{cmx} (max. charging power) [kW]	50,0	--	--	--
Type	Bidirectional	--	--	--
In off-grid battery mode				
P _{sn} (nom. discharge power) [kW]	50,0	--	--	--
P _{smax} (max. discharge power) [kW]	50,0	--	--	--



BUREAU
VERITAS

Annex certificate of conformity No. U25-0557

Extract from test report DGHC2412270311EGEU01 issued by a testing laboratory accredited by "A2LA" according to ISO/IEC 17025. The accreditation is only valid for the scope listed in the annex of the accreditation certificate "5200.02".

Interface protection system and interface switch (Network and system protection "NS-protection")	
Type of protection	integrated NS-protection
Assigned to generation unit type	M2HT-25K-150 M2HT-29.9K-150 M2HT-30K-150 M2HT-40K-150 M2HT-50K-150
Integrated interface switch	Type of switching equipment 1: Relay (Model HF172F-200) Type of switching equipment 2: Relay (Model HF172F-200)
	Note: The output is switched off by the inverter bridge and two relay in series in each line and neutral.
Firmware version	V1.00
Note The settings of the product are password protected adjustable. In case the generators are used with an external protection device, the protection settings of the inverters are to be adjusted according to the manufacturer's declaration. The above stated generators are tested according to the requirements in the EN 50549-1 and the Commission Regulation (EU) 2016/631 of 14 April 2016. Any modification that affects the stated tests must be named by the manufacturer/supplier of the product to ensure that the product meets all requirements.	



BUREAU
VERITAS

Annex certificate of conformity No. U25-0557

Extract from test report DGHC2412270311EGEU01 issued by a testing laboratory accredited by "A2LA" according to ISO/IEC 17025. The accreditation is only valid for the scope listed in the annex of the accreditation certificate "5200.02".

Type Approval and declaration of compliance with the requirements of EN 50549-1 and Commission Regulation (EU) 2016/631 of 14 April 2016

Parameter Table

Annex 1 – Parameter list

Name of parameter set		"EN50549"					
Clause(s) / subclause(s) of EN 50549-1:2019+A1:2023	Parameter	Remarks / additional information	configurable value range	Step size	unit	default value	
4.3.2 Interface switch	Single fault tolerance for interface switch required	Requirement met	---	---	---	---	
4.4.2 Operating frequency range	Internal parameter not configurable	Requirement acc. EN 50549-1, table 1 can be met	---	---	---	---	
4.4.3 Minimal requirement for active power delivery at under frequency	Internal parameter not configurable	Requirement acc. EN 50549-1, clause 4.4.3 can be met	---	---	---	---	
4.4.4 Continuous operating voltage range	Upper limit	---	not configurable	---	%U _n	110	
	Lower limit	---	not configurable	---	%U _n	85	
4.5.2 Rate of change of frequency (ROCOF) immunity	Internal parameter not configurable	ROCOF withstand capability ≥ 2Hz/s	---	---	---	---	
4.5.3.2 Generating plant with non-synchronous generating technology (FRT)	Maximum power resumption time	---	Not configurable	---	---	≤ 1s	
	Enable under voltage ride through	---	Enable Disable	---	---	Enable	
	Voltage-Time-Diagram	Voltage-Time-Diagram definition	Requirement acc. EN 50549-1, figure 6 (default requirement) can be met			Time	U
	V1		0.0 – 100.0	0.1	%U _n		5,0
	T1		0.00 – 65.00	0.01	s	0.00	
	V2		0.0 – 100.0	0.1	%U _n		5,0
	T2		0.00 – 65.00	0.01	s	0.26	
	V3		0.0 – 100.0	0.1	%U _n		25,0
	T3		0.00 – 65.00	0.01	s	0.92	
	V4		0.0 – 100.0	0.1	%U _n		50,0
	T4		0.00 – 65.00	0.01	s	1.88	
	V5		0.0 – 100.0	0.1	%U _n		75,0
	T5		0.00 – 65.00	0.01	s	2.70	
V6		0.0 – 100.0	0.1	%U _n		85,0	
T6		0.00 – 65.00	0.01	s	2.70		
4.5.4 Over-voltage ride through (OVRT)	Enable over voltage ride through	---	Enable Disable	---	---	Enable	
	Voltage-Time-Diagram	Voltage-Time-Diagram definition	Requirement acc. EN 50549-1, figure 8 can be met			Time	U
	V1		0.0 – 130.0	0.1	%U _n		125.0
	T1		0.00 – 65.00	0.01	s	0.00	
	V2		0.0 – 130.0	0.1	%U _n		125.0
	T2		0.00 – 65.00	0.01	s	0.20	
	V3		0.0 – 130.0	0.1	%U _n		120.0
	T3		0.00 – 65.00	0.01	s	0.20	
V4		0.0 – 130.0	0.1	%U _n		120.0	



Annex certificate of conformity No. U25-0557

Extract from test report DGHC2412270311EGEU01 issued by a testing laboratory accredited by "A2LA" according to ISO/IEC 17025. The accreditation is only valid for the scope listed in the annex of the accreditation certificate "5200.02".

Name of parameter set		"EN50549"					
Clause(s) / subclause(s) of EN 50549-1:2019+A1:2023	Parameter	Remarks / additional information	configurable value range	Step size	unit	default value	
	T4		0.00 – 65.00	0.01	s	5.10	
	V5		0.0 – 130.0	0.1	%U _n	115.0	
	T5		0.00 – 65.00	0.01	s	5.10	
	V6		0.0 – 130.0	0.1	%U _n	115.0	
	T6		0.00 – 65.00	0.01	s	61.00	
	V7		0.0 – 130.0	0.1	%U _n	110.0	
	T7		0.00 – 65.00	0.01	s	61.00	
4.6.1 Power response to over frequency (LFSSM-O)	Activation frequency	Threshold frequency f1	50 - 65	0.01	Hz	50.20	
	Power gradient	Drop	2 - 12	0.1	%	5.0	
	Overfrequency reference power section	Power reference	P _M P _{max}	---	---	P _M	
	Delay time	Intentional delay	0 - 60	0.1	s	0.0	
4.6.2 Power response to under frequency (LFSSM-U)	Activation frequency	Threshold frequency f1	45 - 50	0.01	Hz	49.80	
	Power gradient	Drop	2 - 12	0.1	%	5.0	
	Underfrequency reference power section	Power reference	P _M P _{max}	---	---	P _M	
	Delay time	Intentional delay	0 - 60	0.1	s	0.0	
4.7.2.2 voltage support by reactive power - Capabilities	Reactive power range overexcited	---	0 - 60.0%P _n	0.1	%P _n	60.0	
	Reactive power range underexcited	---	-60.0%P _n - 0	0.1	%P _n	-60.0	
	Minimum inductive power factor	Active factor range underexcited	0.80 - 1.00	0.01	---	0.80	
	Minimum capacitive power factor	Active factor range overexcited	0.80 - 1.00	0.01	---	0.80	
4.7.2.3 Control modes	Enabled control mode	---	Q setpoint Q(U) cosφ setpoint cosφ(P)	---	---	Q setpoint	
4.7.2.3.2 Set point control modes (Q setpoint and excitation)	Reactive power setting value	---	-60.0%P _n ~+60.0%P _n	0.1	%P _n	0	
	Delay time	---	0 - 60	0.1	s	0.0	
	Tau value	PT1-filtering time constant	0 - 60	0.1	s	3.0	
4.7.2.3.2 Set point control modes (cosφ setpoint and excitation)	cosφ setting value	---	-0.80~1.0~0.80	0.01	---	1.0	
	Delay time	---	0 - 60	0.1	s	0.0	
	Tau value	PT1-filtering time constant	0 - 60	0.1	s	3.0	
4.7.2.3.3 Voltage related control modes - Q(U)	Voltage node 1	---	0 - 300	0.1	V	213.9	
	Voltage node 2	---	0 - 300	0.1	V	223.1	
	Voltage node 3	---	0 - 300	0.1	V	236.9	
	Voltage node 4	---	0 - 300	0.1	V	246.1	
	Reactive Power responding node 1	---	0 - 100	0.1	%P _n	60.0	
	Reactive Power responding node 2	---	0 - 100	0.1	%S _n	0	



BUREAU
VERITAS

Annex certificate of conformity No. U25-0557

Extract from test report DGHC2412270311EGEU01 issued by a testing laboratory accredited by "A2LA" according to ISO/IEC 17025. The accreditation is only valid for the scope listed in the annex of the accreditation certificate "5200.02".

Name of parameter set		"EN50549"				
Clause(s) / subclause(s) of EN 50549-1:2019+A1:2023	Parameter	Remarks / additional information	configurable value range	Step size	unit	default value
	Reactive Power responding node 3	---	0 - 100	0.1	%S _n	0
	Reactive Power responding node 4	---	-100 - 100	0.1	%P _n	-60.0
	Delay time	---	0 - 60	0.1	s	0.0
	Tau value	PT1-filtering time constant	0 - 60	0.1	s	3.0
4.7.2.3.4 Power related control mode - cosφ(P)	PF Node 1	---	0 - 1	0.01	---	1.00
	PF Node 2	---	0 - 1	0.01	---	1.00
	PF Node 3	---	-1 - 1	0.01	---	0.90
	Power node 1	---	0 - 100	0.1	%S _n	10.0
	Power node 2	---	0 - 100	0.1	%S _n	50.0
	Power node 3	---	0 - 100	0.1	%S _n	100.0
	Tau Value	PT1-filtering time constant	0 - 60	0.1	s	3.0
4.7.2.3.4 Power related control mode - (cos φ (P))	Ena	disable / enable	[0 / 1]	---	---	0
	PF	---	-0.90 - 0.90	0.01	---	- 0.9
	Time	---	0.5 - 1800.0	---	s	---
4.7.4.2.2 Zero current mode for converter connected generating technology	Threshold value of under voltage	---	not configurable	---	p.u.@U _n	0.8
	Threshold value of over voltage	---	not configurable	---	p.u.@U _n	1.14
4.9.2 Requirements on voltage and frequency protection	Undervoltage Protection value Level_1(V)	Undervoltage threshold stage 1	46.0 - 230.0	0.1	V	184.0
	Undervoltage Disconnection Time Level_1(V)	Undervoltage operate time stage 1	10 - 100000	10	ms	1000
	Undervoltage Protection value Level_2(V)	Undervoltage threshold stage 2	46.0 - 230.0	0.1	V	---
	Undervoltage Disconnection Time Level_2(V)	Undervoltage operate time stage 2	10 - 5000	10	ms	---
	Overvoltage Protection value Level_1(V)	Overvoltage threshold stage 1	230.0 - 276.0	0.1	V	264.5
	Overvoltage Disconnection Time Level_1(V)	Overvoltage operate time stage 1	10 - 100000	10	ms	1000
	Overvoltage Protection value Level_2(V)	Overvoltage threshold stage 2	230.0 - 299.0	0.1	V	---
	Overvoltage Disconnection Time Level_2(V)	Overvoltage operate time stage 2	10 - 5000	10	ms	---
	10min overvoltage Protection Value	Overvoltage threshold 10min mean protection	230.0 - 264.5	0.1	V	253.0
	10-min mean Disconnection Time	Overvoltage operate time 10 min mean protection	0 - 3 s	---	---	10 min (update every 3s)
	Underfrequency Protection value Level_1	Underfrequency threshold stage 1	47.00 - 50.00	0.01	Hz	47.5Hz



**BUREAU
VERITAS**

Annex certificate of conformity No. U25-0557

Extract from test report DGHC2412270311EGEU01 issued by a testing laboratory accredited by "A2LA" according to ISO/IEC 17025. The accreditation is only valid for the scope listed in the annex of the accreditation certificate "5200.02".

Name of parameter set		"EN50549"				
Clause(s) / subclause(s) of EN 50549-1:2019+A1:2023	Parameter	Remarks / additional information	configurable value range	Step size	unit	default value
	Underfrequency Disconnection Time Level_1	Underfrequency operate time stage 1	10 - 100000	10	ms	100
	Underfrequency Protection value Level_2	Underfrequency threshold stage 2	47.00 - 50.00	0.01	Hz	---
	Underfrequency Disconnection Time Level_2	Underfrequency operate time stage 2	10 - 5000	10	ms	---
	Overfrequency Protection value Level_1	Overfrequency threshold stage 1	50.00 - 52.00	0.01	Hz	51.5
	Overfrequency Disconnection Time Level_1	Overfrequency operate time stage 1	10 - 100000	10	ms	100
	overfrequency Protection value Level-2	Overfrequency threshold stage 2	50.00 - 52.00	0.01	Hz	---
	overfrequency Disconnection Time Level-2	Overfrequency operate time stage 2	10 - 5000	10	ms	---
4.10.2 Automatic reconnection after tripping	Start up time following grid error	---	0 - 900	1	s	60
	Power gradient following grid error (%/min)	---	0 - 100	0.1	%/min	8.0
	Max. grid reconnection voltage	---	0 - 300	0.1	V	253.0
	Min. grid reconnection voltage	---	0 - 300	0.1	V	195.5
	Max. grid reconnection frequency	---	45 - 65	0.1	Hz	50.2
	Min. grid reconnection frequency	---	45 - 65	0.1	Hz	49.5
4.10.3 Starting to generate electrical power	Start up time	---	0 - 900	0.1	s	60.0
	Power gradient	---	0 - 100	0.1	%/min	8.0
	Max. grid start voltage	---	0 - 300	0.1	V	253.0
	Min. grid start voltage	---	0 - 300	0.1	V	195.5
	Max. grid start frequency	---	45 - 65	0.1	Hz	50.1
	Min. grid start frequency	---	45 - 65	0.1	Hz	49.5
4.11.1 Ceasing active power	---	---	---	---	---	RS485
4.11.2 Reduction of active power on set point	Temporary Active Power Setting		0 - 100	0.1	%	100.0
	Active Power Slope Setting		[0 - 100]	0.1	%/min	30.0
4.12 Remote information exchange	---	---	---	---	---	---